




Tvirtinu:
UAB "Palangos šilumos tinklai"
Direktorė G. Jursėnė

2026m. 10m. 10d.

Lauko oro temperatūra		Parametrai katilinės išėjime																					Optimalus	Termof. grįžtama linija		
T	Q	I režimas			II režimas			III režimas			IV režimas			V režimas			VI režimas			VII režimas				T1	T2	P2
°C	MW	T1.1	G1.1	P1.1	T1.2	G1.2	P1.2	T1.3	G1.3	P1.3	T1.4	G1.4	P1.4	T1.5	G1.5	P1.5	T1.6	G1.6	P1.6	T1.7	G1.7	P1.7		°C	°C	bar
10	8.7	68	287	4.0																				68	40	2.2
9	9.2	68	283	4.0																				68	40	2.2
8	9.7	68	279	4.0																				68	40	2.2
7	10.2	68	275	4.0																				68	40	2.2
6	10.7	68	271	4.0																				68	40	2.2
5	11.2	68	267	4.0																				68	40	2.2
4	11.8	68	263	4.0																				68	40	2.2
3	12.4	68	259	4.0																				68	40	2.2
2	13.0	68	255	4.0																				68	40	2.2
1	13.6	68	251	4.0	70	385	4.0																	68	40	2.2
0	14.2	68	247	4.0	70	415	4.0																	68	41	2.2
-1	14.8	68	243	4.0	70	448	4.0																	68	42	2.2
-2	15.4	68	239	4.0	70	477	4.0																	70	42	2.2
-3	16.0				70	514	4.0	75	434	4.0														71	43	2.2
-4	16.8				70	561	4.0	75	470	4.0														73	44	2.2
-5	17.5				70	603	4.0	75	502	4.0														74	45	2.2
-6	18.2							75	540	4.0	80	480	4.0											76	46	2.2
-7	18.6							75	575	4.0	80	486	4.0											76	47	2.2
-8	19.5							75	618	4.0	80	522	4.0											79	48	2.2
-9	20.1										80	551	4.0	85	475	4.0								81	49	2.2
-10	20.9										80	591	4.0	85	508	4.0								82	50	2.2
-11	21.5										80	627	4.0	85	537	4.0								84	51	2.2
-12	22.2													85	566	4.0	90	494	4.0					85	51	2.2
-13	22.8													85	600	4.0	90	519	4.0					87	52	2.2
-14	23.4													85	634	4.0	90	547	4.0					89	53	2.2
-15	24.1																90	576	4.0	95	505	4.0	90	54	2.2	
-16	24.8																90	608	4.0	95	533	4.0	92	55	2.2	
-17	25.4																90	640	4.0	95	559	4.0	94	56	2.2	
-18	26.0																			95	588	4.0	95	57	2.2	
-19	26.7																			95	615	4.0	95	58	2.2	
-20	27.3																			95	645	4.0	95	59	2.2	
-21	27.9																			95	686	4.0	95	59	2.2	

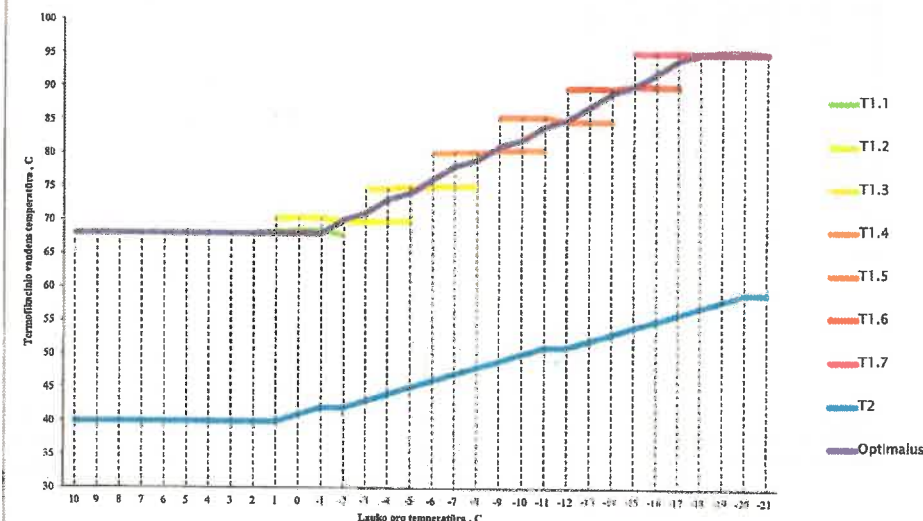

PASTABA: 1. Lauko oro temperatūrai esant žemesnei negu -20 °C, įvedamas paduodamo termofikacinio vandens temperatūros ribojimas, temperatūra paduodama į tinklus negali viršyti 95 °C.

Sudarė:
Inžinierius-projektuotojas
Šarūnas Dirmeikis

Suderinta:
Direktoriaus pavaduotojas gamybai
Algirdas Smulkys